



THE REMEDIAL ANSWER

Time for Remedial Action?

Following the fixed wire inspection & testing on site, it is highly likely that the subsequent Electrical Installation Condition Report (EICR) will include observations which will be referenced by some, or all of the BS 7671 Wiring Regulations classification codes: C1: Danger Present – Risk of injury, C2: Potentially Dangerous – Urgent remedial action required, C3: Improvement Recommended and FI: Further Investigation - Required without delay. Despite our bi-monthly reminders, recent client analysis demonstrates that 50% do not evidence, via minor works certification, closure of outstanding C1, C2, C3 and FI observations.

Given these statistics, which have remained a constant for the last 2 years, Guardian have now taken the step of offering a remedial service to ensure timely completion of corrective actions. Additionally, you will have peace of mind that your real time TraQit bar charts will be updated to ensure records are current, accurate and consolidated with a version history of all system changes. On completion of certified system changes, automatic email alerts will be issued to all listed Dutyholders, guaranteeing they are kept in the loop and effectively monitoring the changes.



What if I don't undertake Remedial Action?

As Dutyholder and from a legal perspective, you are in a more onerous position should an incident occur which leads to a breach of EaWR 1989. ie, you knew about it, but still did nothing. From an insurance perspective, you cannot be insured against non-compliance with an absolute regulation, the wording can often be found in the Insurers small print.

Under Dutyholder Regulation 3 of EaWR 1989:

It shall be the Duty of every Employer, Director, Manager, Supervisor and Employee whilst at work to: *"comply with the provisions of the Electricity at Work Regulations 1989, in so far as matters which are within your **CONTROL**"*

Furthermore, Reg 4 (1) and (2) of EaWR 1989 state

*As may be necessary to prevent danger, **all systems**, shall at **all times** be of such **construction**, so as not to give rise to danger.*

- **All systems** – from a battery to a Power Station
- **All times** – no days off, no respite
- **Construction** – designed, installed, maintained and operated

The foregoing regulations state that if you are responsible and in control of the electrical system, you have a legal obligation to ensure it remains safe at all times.



Guardian

ELECTRICAL COMPLIANCE

SAFE PEOPLE | SAFE PLACES | SAFE SYSTEMS

A PTSG company

CALL 0114 257 2080 FOR MORE INFORMATION




THE REMEDIAL ANSWER

Why choose Guardian?

From the initial appointment with our sales engineer, the professional service of our directly employed inspectors, through to the TraQit and remedial departments, and technical and legislative update service, Guardian offer an unparalleled cradle to grave solution, in respect of compliance with the relevant aspect of the Electricity at Work Regulations 1989.

- **Unrivalled customer service**
- **Remedial quotes issued within five days on completion of testing**
- **Real time access to updated corrective action documents**
- **Automatic email alerts on completion of certification via TraQit**
- **Remedial loop closed and Dutyholder responsibilities discharged**
- **Free editing and updates**
- **Total Record Control**

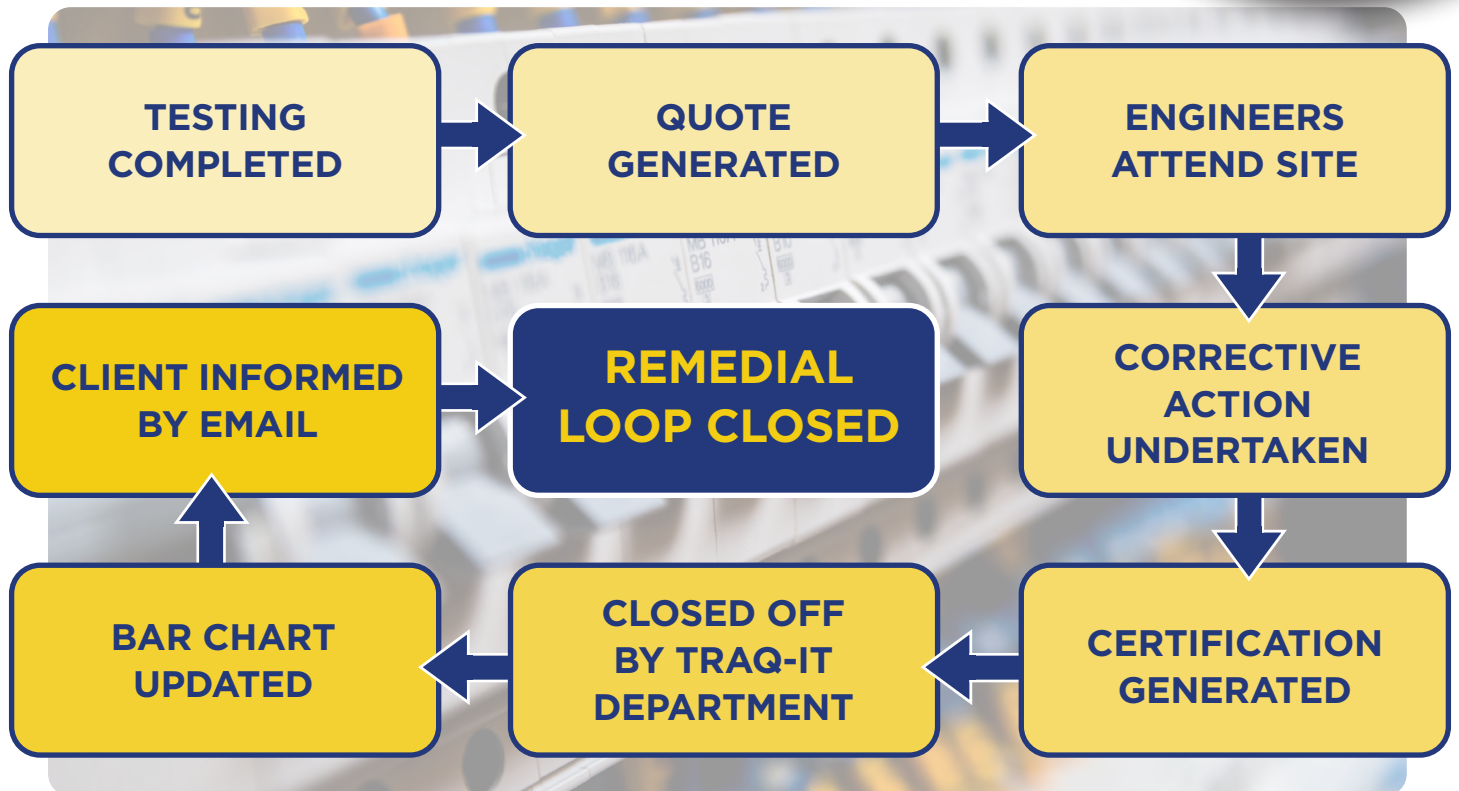

Additional Services

- Lighting Upgrade Works (Energy saving LED luminaires)
- Emergency Lighting Repairs and Upgrades
- Switch Panel and Distribution Board Replacement Works
- New Power Supplies
- Power Factor Correction (PFC) Servicing
- Surge Protective Devices (SPD) Installations
- Verification Works
- HV Transformer Replacements
- Panel Risk Assessment (RAGS) Repairs



2 Park Square, Thorncliffe Business Park, Chapeltown, Sheffield. S35 2PH
Tel: 0114 257 2080 Web: www.guardianelectrical.co.uk

Guardian
ELECTRICAL COMPLIANCE
SAFE PEOPLE | SAFE PLACES | SAFE SYSTEMS

A PTSG company